



Modeled Temperature Gradients during Cooling Outages

February 25, 2008
Critical Facilities Round Table
Think Tank Meeting
PG&E Pacific Energy Center
San Francisco, CA


Magnus K. Herrlin, Ph.D., CEM
President

mherrlin@ancis.us


www.ancis.us

Advanced Indoor Environmental and Energy Solutions for Mission-Critical Facilities

Data Center Architectures

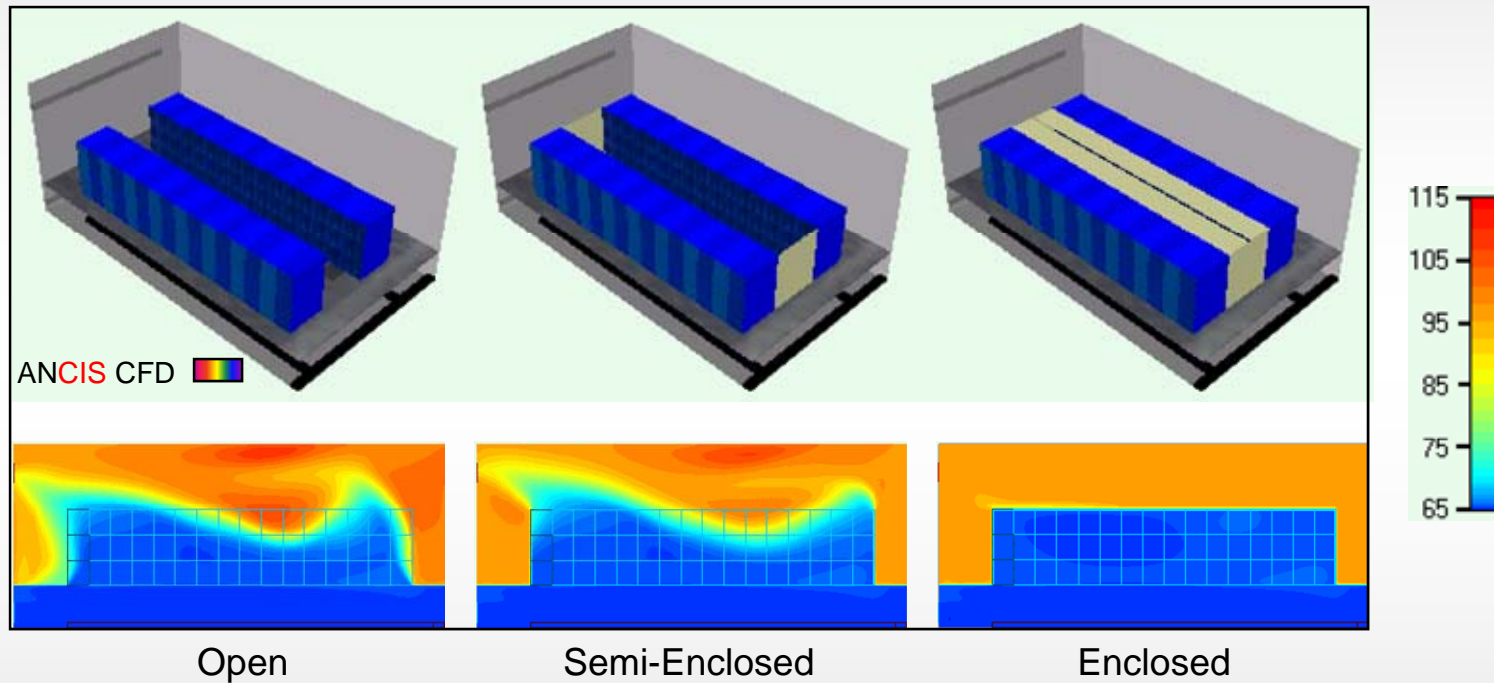

Example: Open Architecture

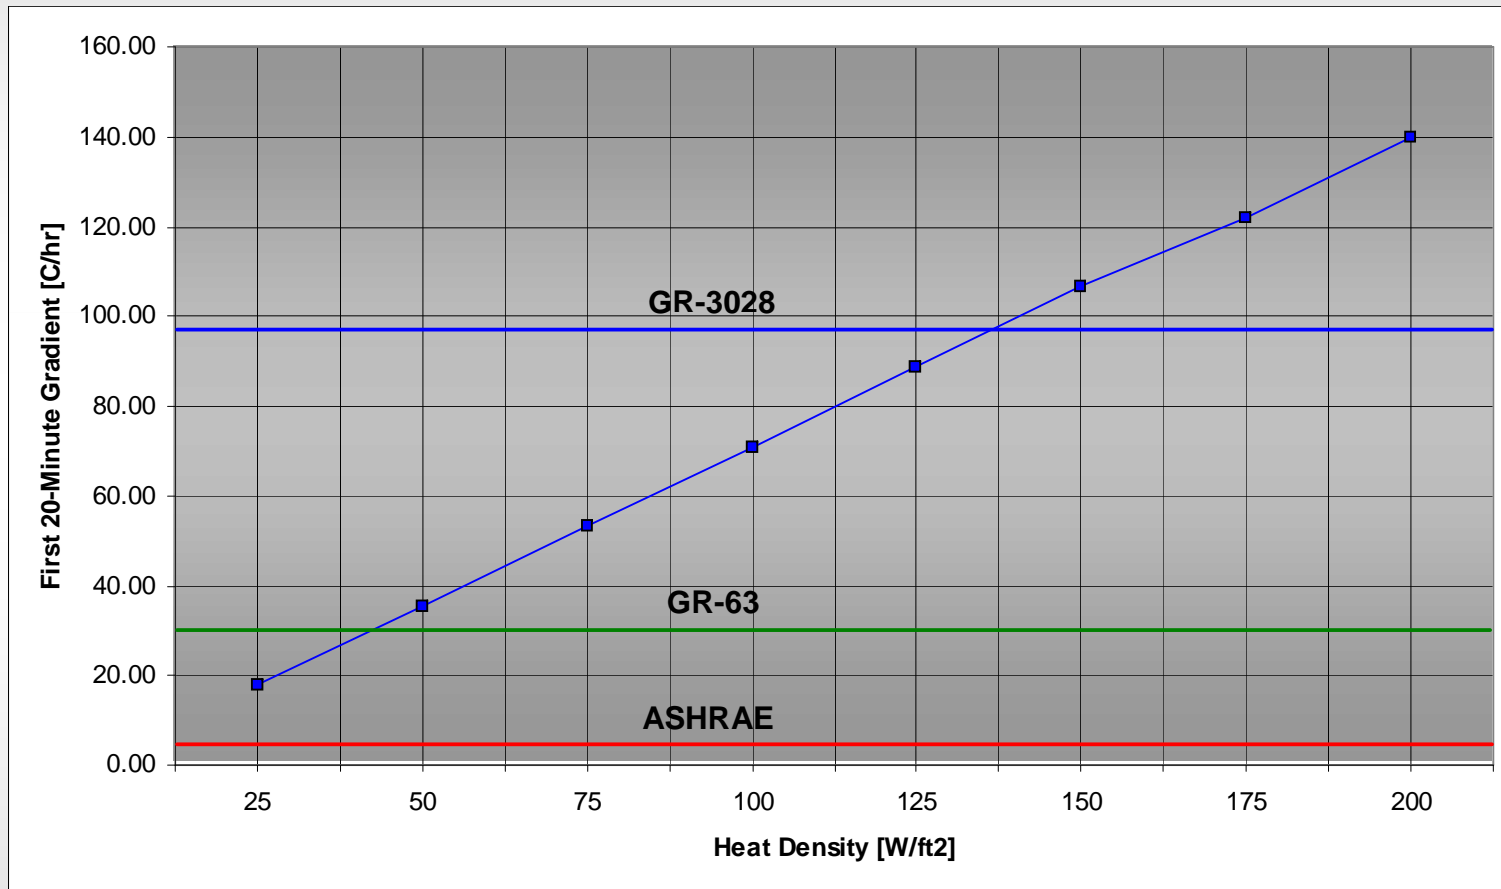

Example: Enclosed Architecture

